




416

STRANDWOOD
ELEMENTARY
SCHOOL

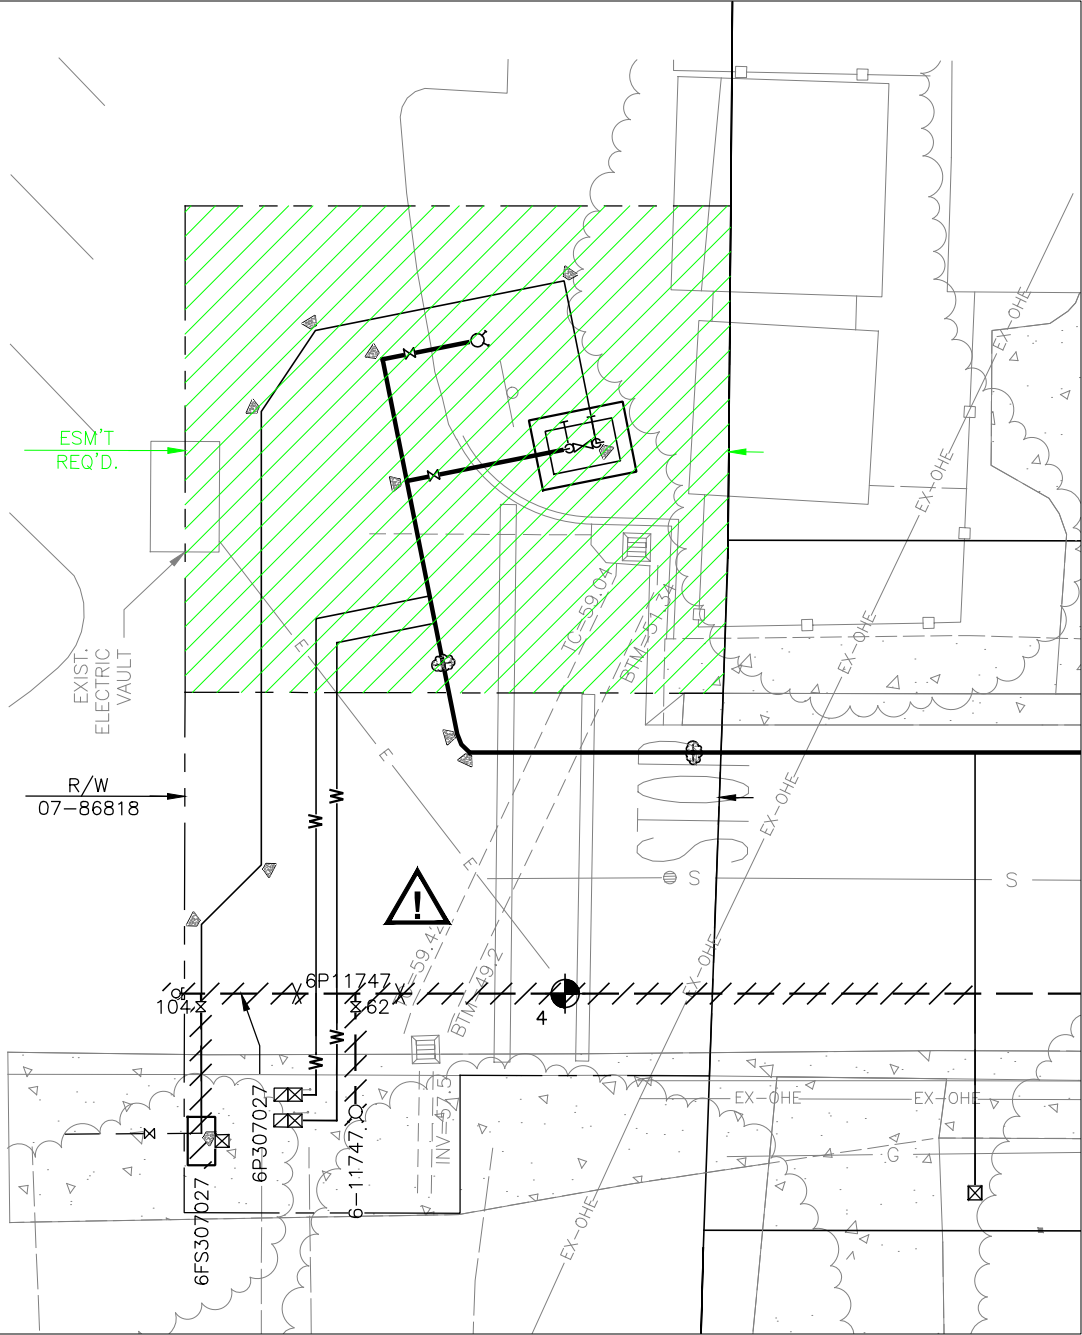

POLE TO BE
REMOVED

NEW. 6" FIRE
HYDRANT LOCATION

NEW. 6" DCDA

NEW. CAGE OVER
FIRE SERVICE

NEW. CONCRETE
PAD

ESMT REQ'D

STRANDWOOD
ELEMENTARY
SCHOOL

